

NOTES:


CONCRETE SHALL BE CLASS AA, 4000 PSI AS PER ASTM C-478.

STEEL REINFORCING SHALL MEET ASTM C-185 (4" DIA) OR ASTM C-478 (5" DIA).

MANHOLES OVER 3'-6" IN DEPTH SHALL BE PROVIDED WITH STEPS 16" ON CENTERS. STEPS SHALL BE IN ACCORDANCE WITH COG STD. #206.

ON NEW INSTALLATION A MAXIMUM OF (2) GRADE RINGS CAN BE USED.

ALL PIPE TO BE MINIMUM 2" BRASS AND NIPPLES TO BE 2" BRASS.

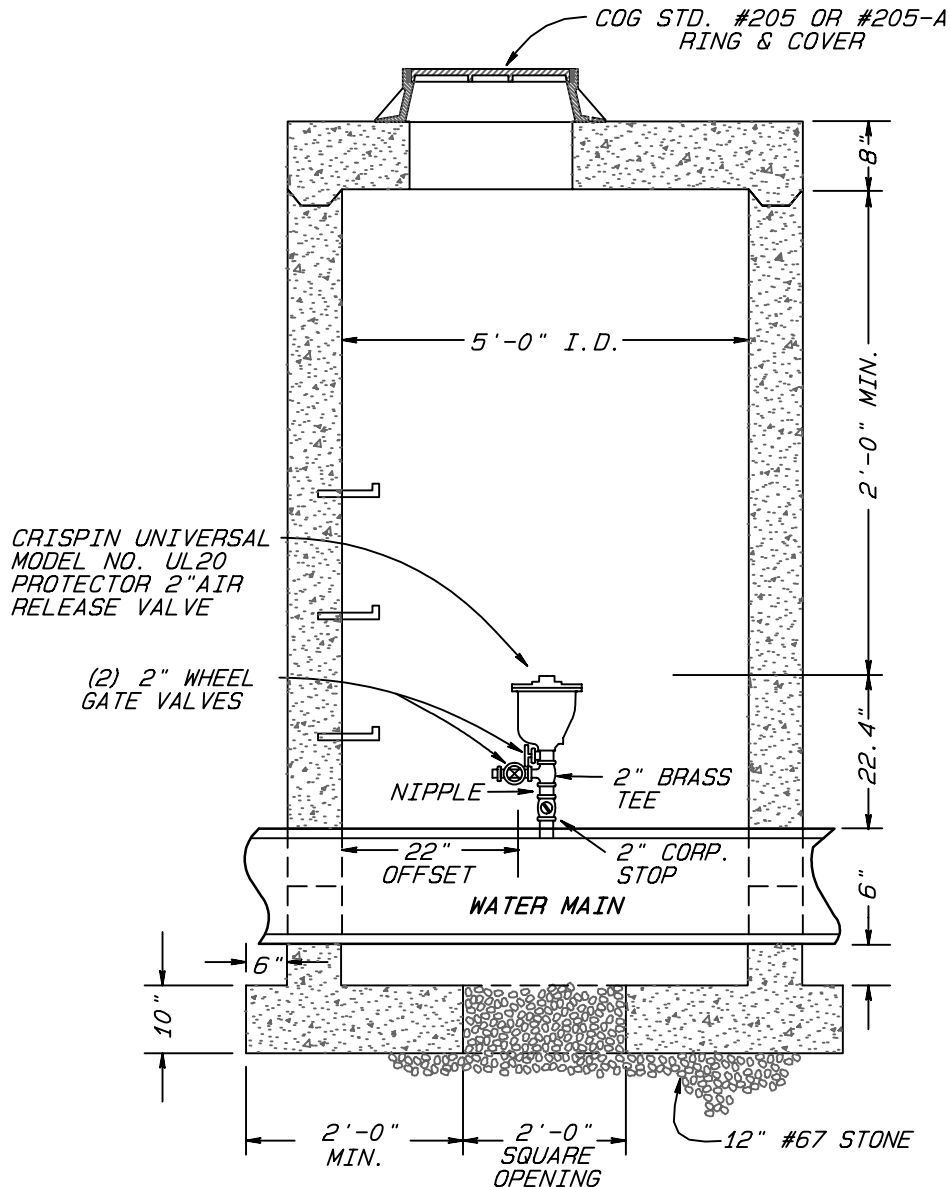

SECTION THRU MANHOLE

C I T Y O F G R E E N S B O R O

**STANDARD AIR RELIEF VALVE WITH ASSEMBLY
AND MANHOLE FOR WATER LINES**

STD. NO.

116

REV.

06-99 09-02
11-01
08-02